


NC FDAS signal to the control panel.
Possibly heat or smoke detector
on both sides of the fire curtain.

ELECTRICAL REQUIREMENTS - FK ROLL EI - FDAS (EN)

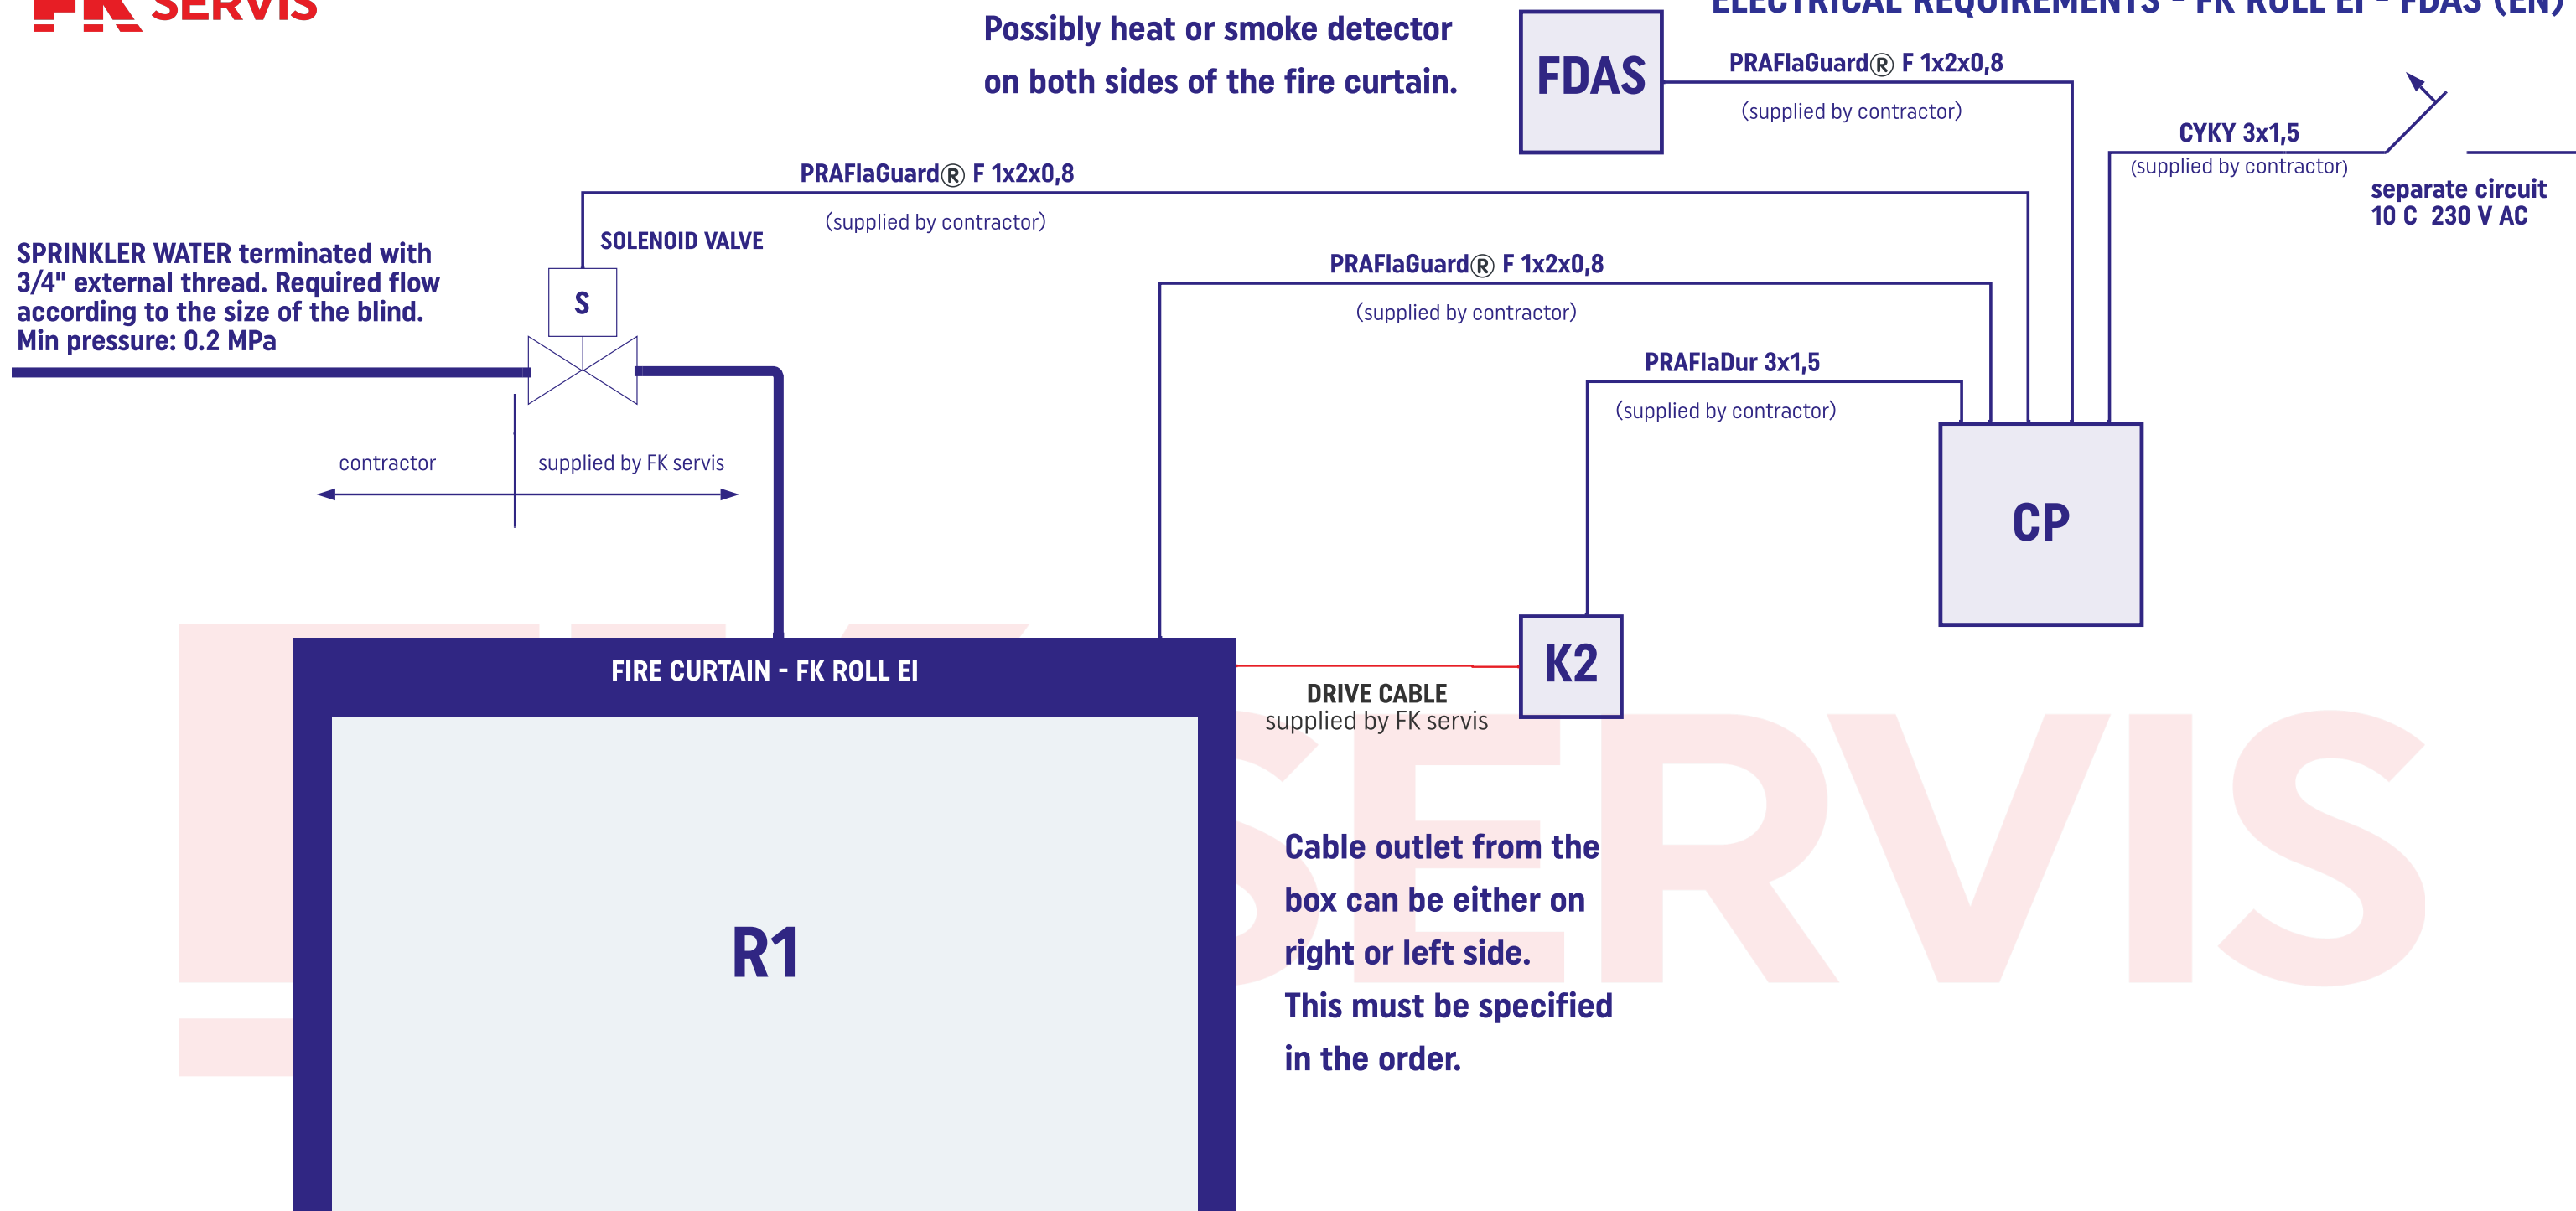

CP: control panel FK ROLL +, 400x300x150 mm, surface mounting, steel box, cable inlet ot top side

K2: current comparator, 120x120x50 mm, surface mounting

R1: Fire curtain - FK ROLL EI

Cables requirements to be supplied by contractor are marked.

This diagram is for guidance only. The specific scheme will be specified according to the specifications and requirements of the customer!